SEPARABLE CONNECTORS 600 SERIES DEADBREAK

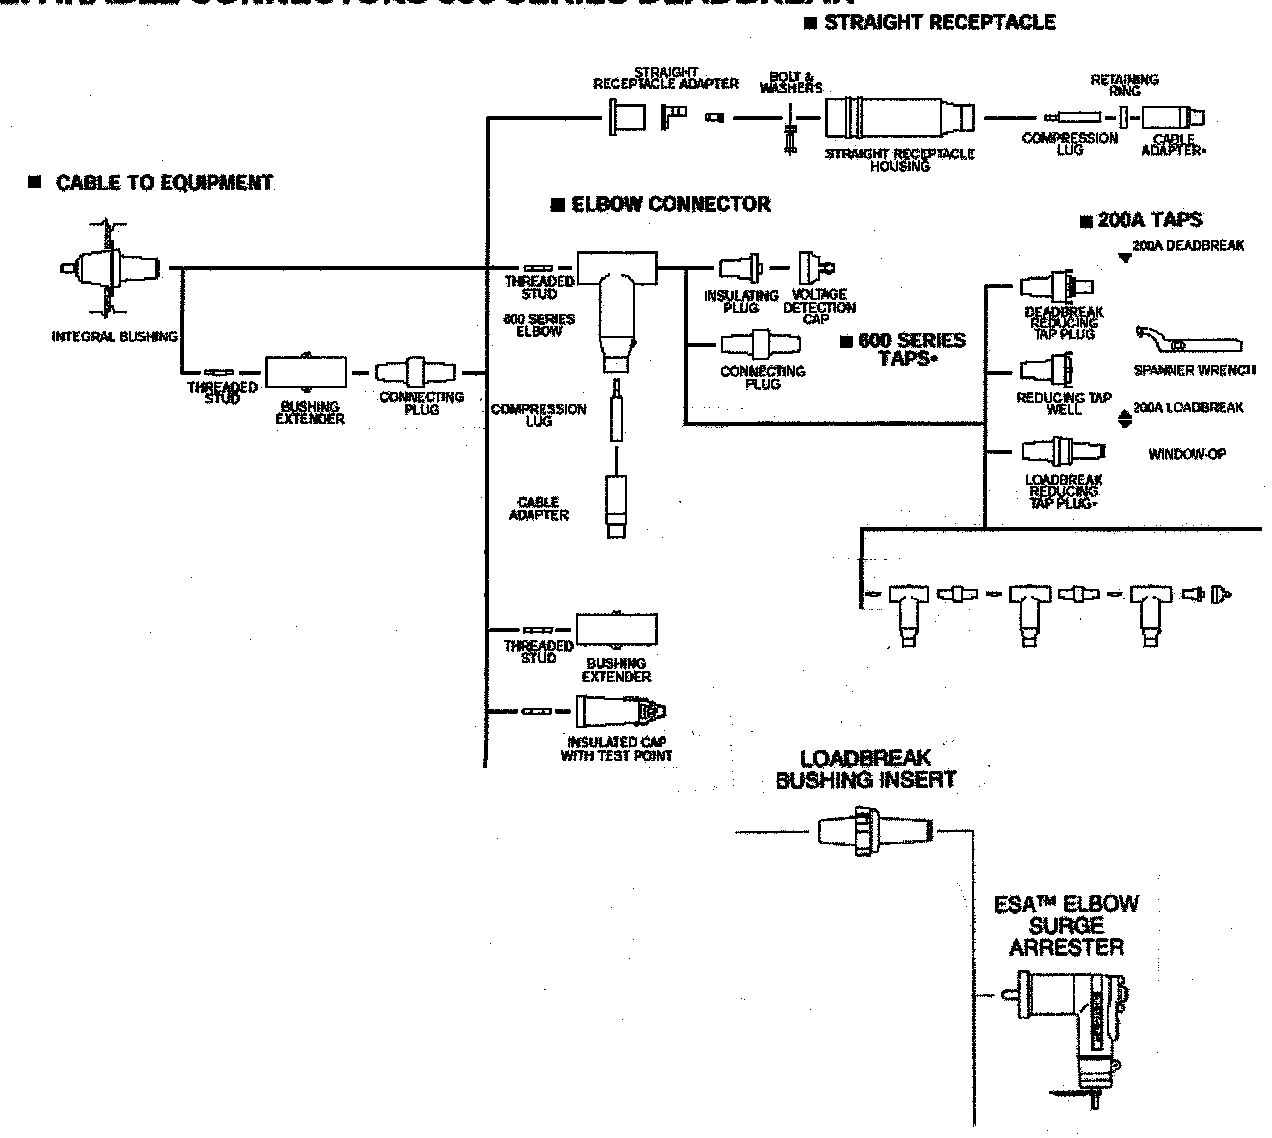

NO.	REVISION	DATE	BY	CK	P.E. STAMPED BY	P.E. No.
A	ISSUED FOR REVIEW	11/5/03	SP	DPE	000	000

CLIENT APPROVAL

000 APPROVED BY

000 COMPANY

00/00/01 DATE

DPE DESIGNED

SP DRAWN

000 CHECKED

000 APPROVED

REVIEWED

000

000

REDINGTON WIND FARM PROJECT

COLLECTOR SYSTEM CABLE CONNECTORS

34.5KV TRANSMISSION

REDINGTON TOWNSHIP MAINE

E·PRO Engineering & Environmental Consulting, LLC 249 Western Avenue, Augusta, Maine 04330

SCALE NONE DATE 11/5/03

10166–E501 SHEET #8

REV. A

FILENAME:34.5KVTRANSMSH8.DWG

E·PRO Engineering & Environmental Consulting, LLC 249 Western Ave, Augusta, Maine 04330

CONTRACT DWG NO. 10166–E500SH.8 PROJECT NO. 10166

THIS DRAWING SHALL BE REVISED ON THE CADD SYSTEM ONLY