


POSSIBLE POSITION OF GENERATOR STACKS - DISCHARGE ELEVATION APPROXIMATELY 45 FEET ABOVE GRADE

CENTRAL UTILITY PLANT HOUSES ALL GENERATORS

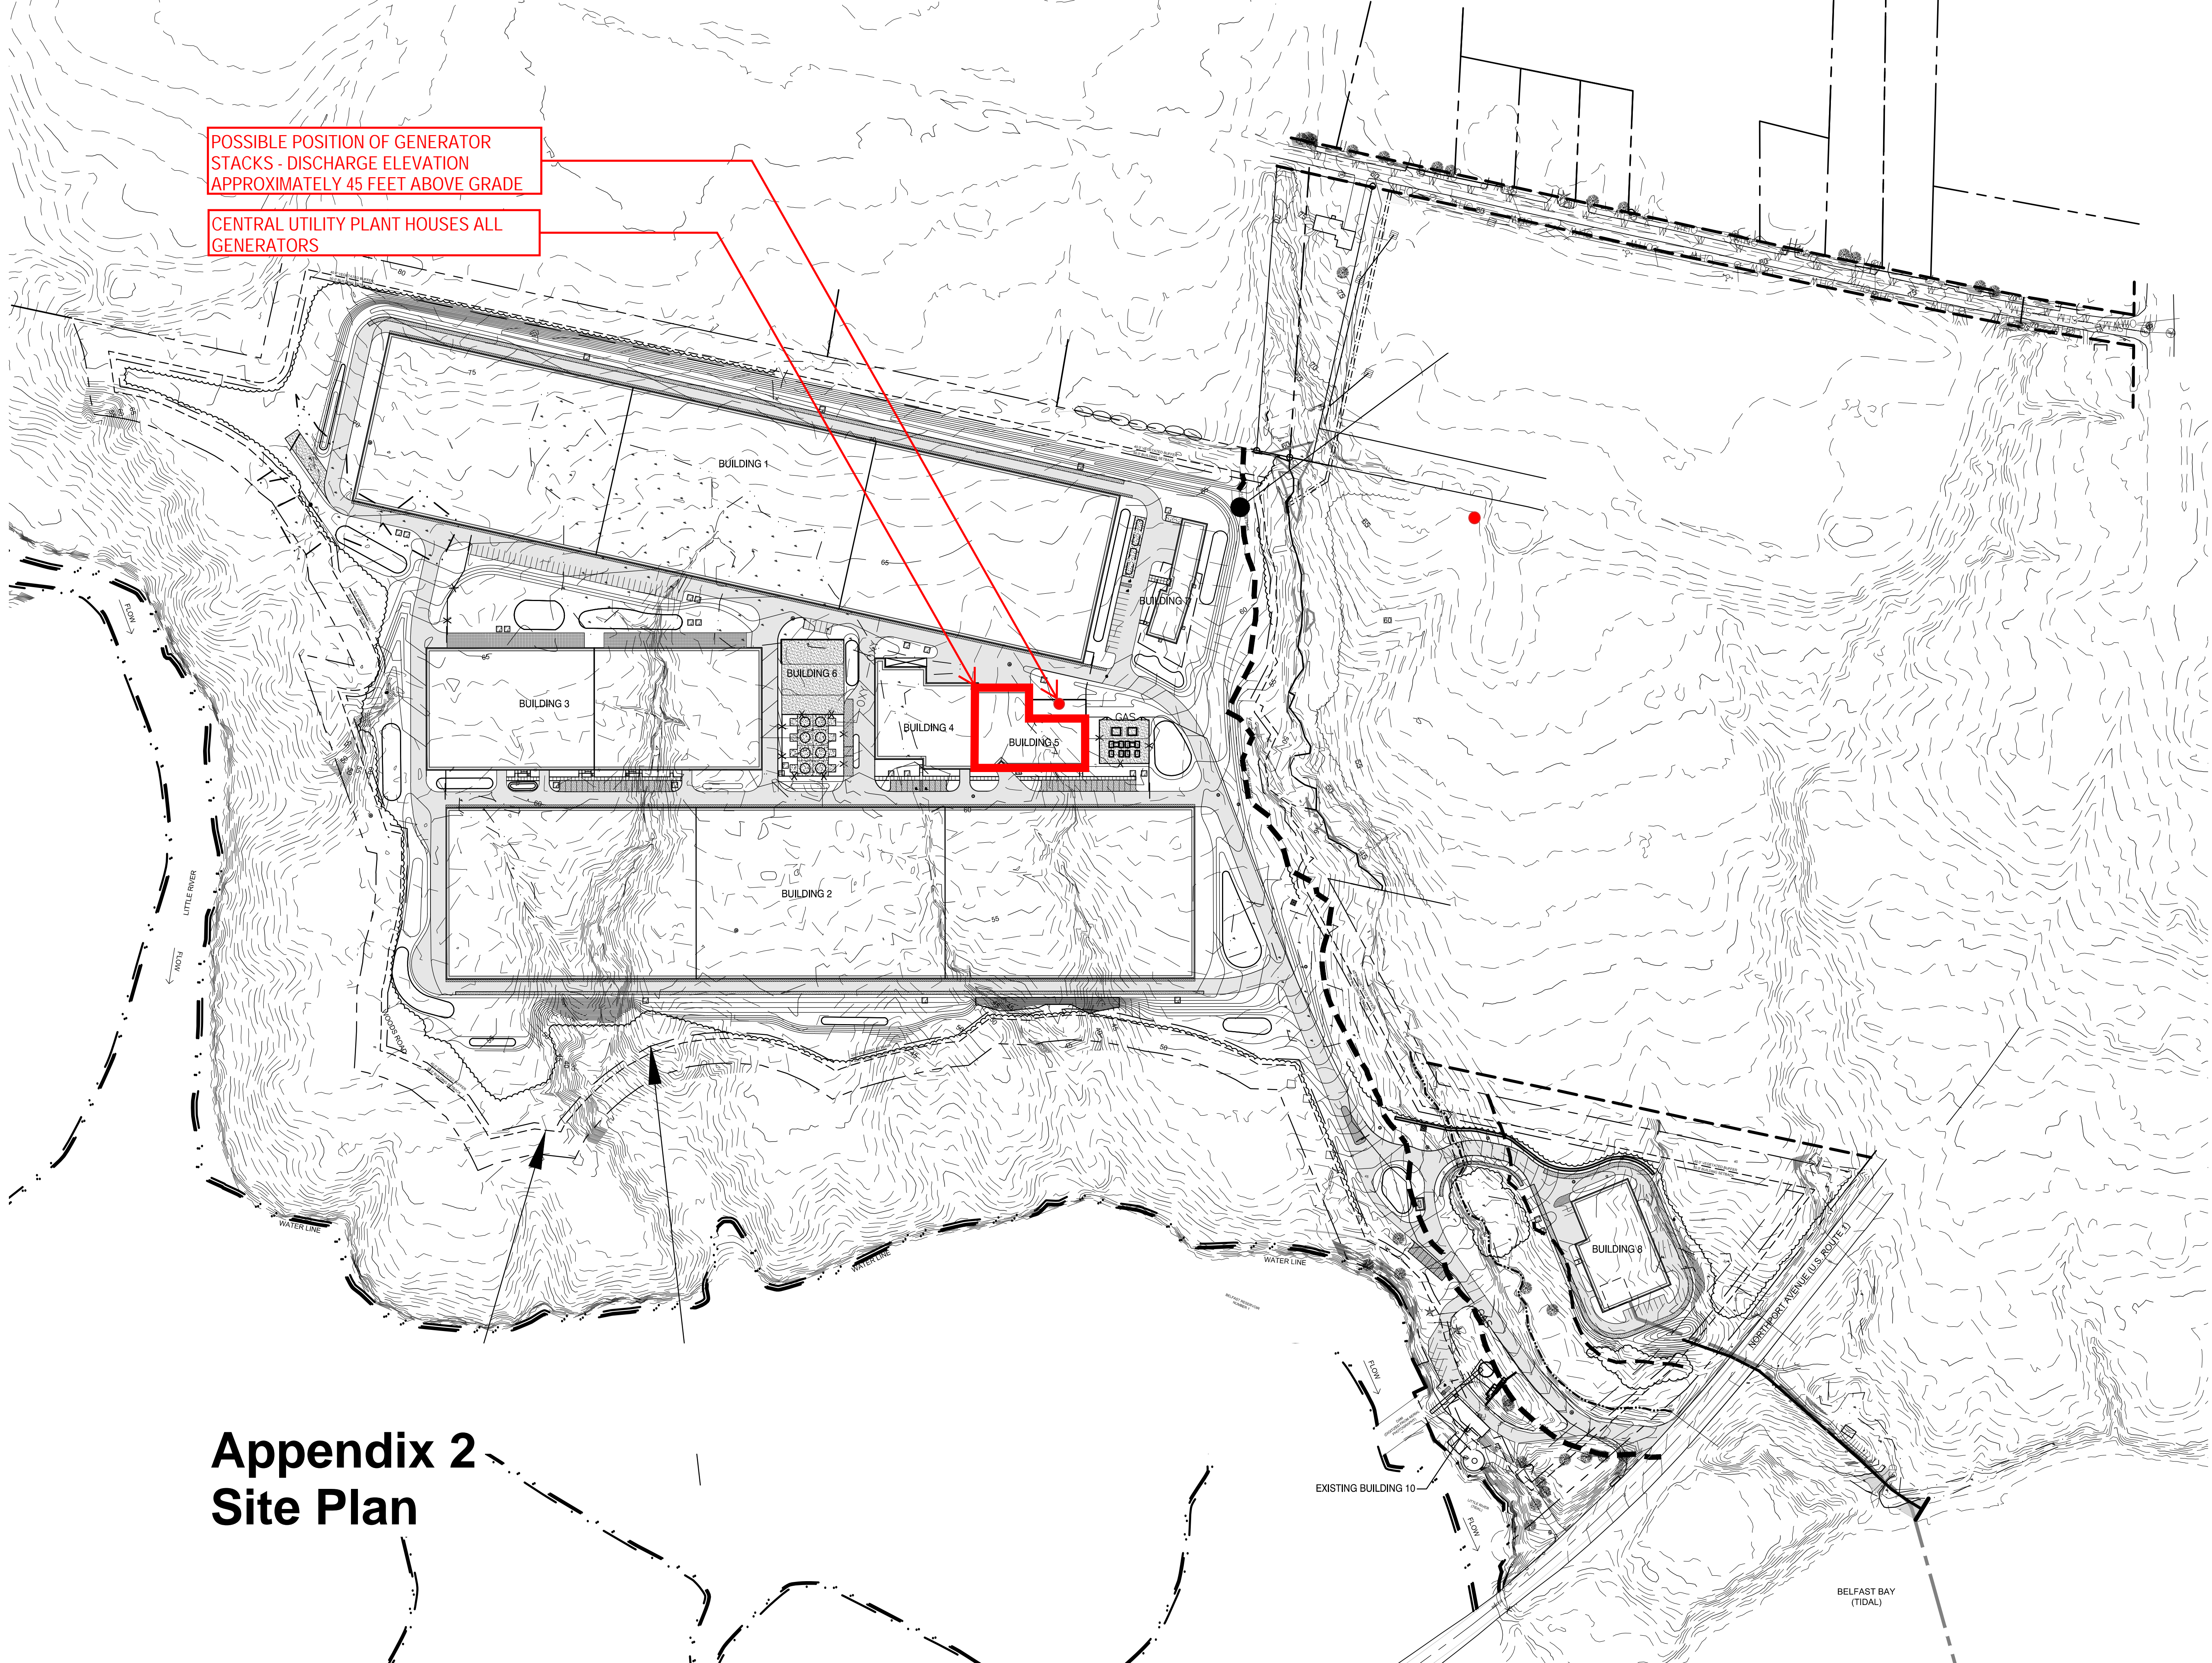

Appendix 2 Site Plan